



TYPICAL LANDFALL HDD COMPOUND

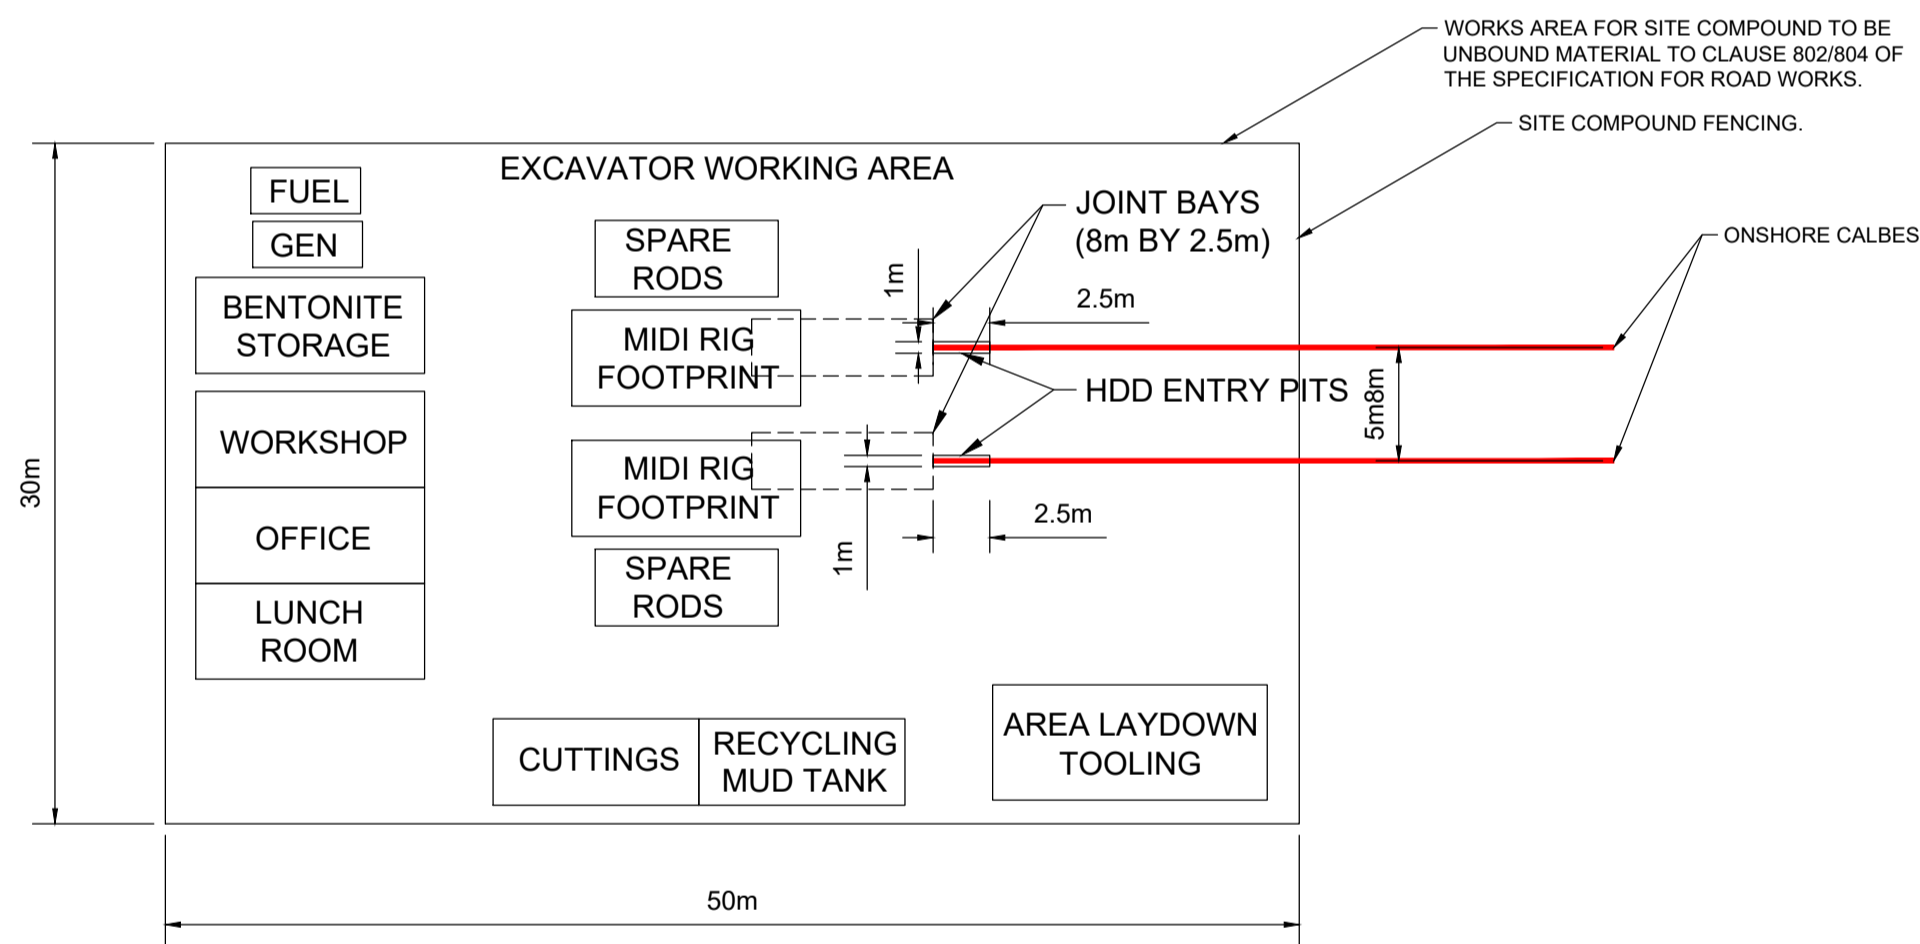

TYPICAL HDD COMPOUND - OTHER LOCATIONS

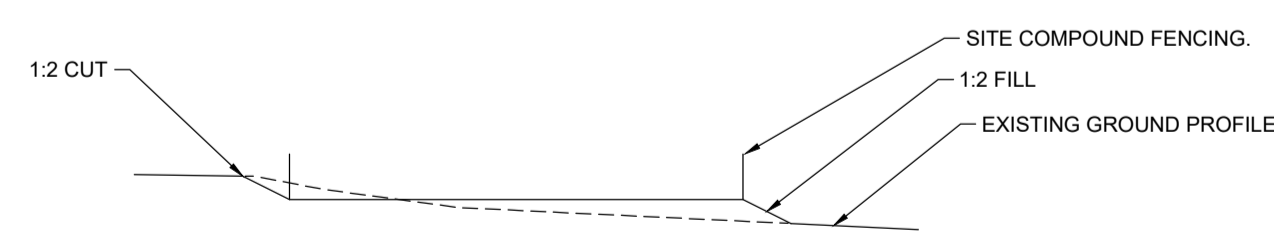

TYPICAL SECTION THROUGH HDD COMPOUND

NOTES.

- REFER TO DRAWINGS 2812400-ARP-SO-XX-DR-PL-1100 I0 1164 FOR PROPOSED ONSHORE CABLE ROUTE AND ASSOCIATED CABLE INFRASTRUCTURE.
- REFER TO DRAWINGS 2812400-ARP-SO-XX-DR-PL-1100 TO 1164 FOR PROPOSED LOCATIONS OF HDD COMPOUND AND ASSOCIATED TEMPORARY AND PERMANENT ACCESS TRACKS.
- ARRANGEMENT, LAYOUT, LEVELS, ETC. OF LANDFALL AND HDD COMPOUNDS - OTHER LOCATIONS TO BE CONFIRMED BY CONTRACTOR DESIGN.

Rev	Date	By	Chkd	Appd
C01	May 2024	EAM	RM	MD
P01	16.02.24	EM	ID	FP



Client  
North Irish Sea Array Windfarm Ltd.

Project Title  
North Irish Sea Array (NISA)

Drawing Title  
TYPICAL HDD COMPOUND LAYOUTS

Scale at A1  
AS INDICATED

Role  
Civil

Suitability  
A2 - Approved for Planning

Arup Job No  
D00

Rev  
C01

Name  
281240-ARP-ONS-XX-DR-PL-3009